
Vacuum filters


FESTO

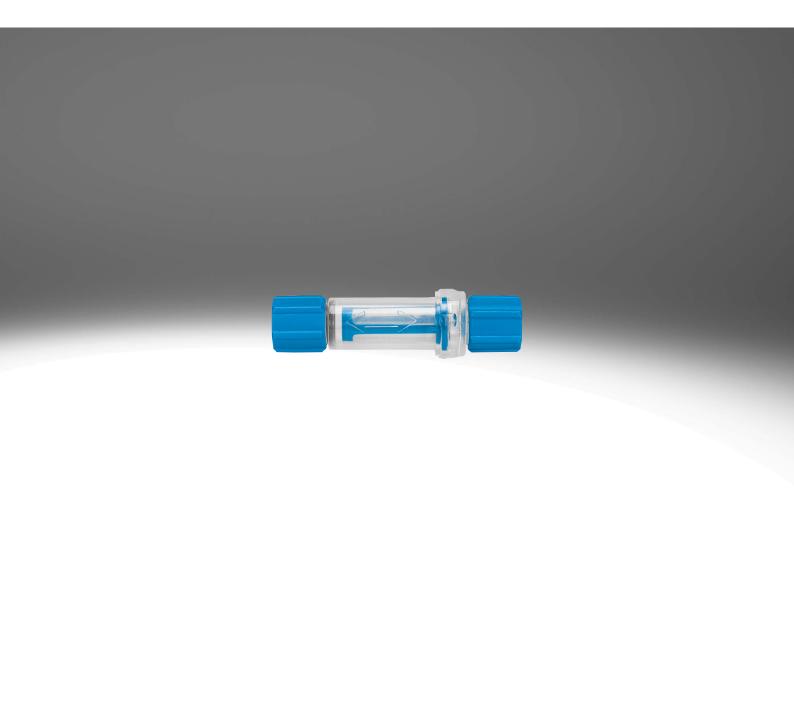

Datasheet

Accessory for suction gripper ESG, mounting between suction cup holder and suction cup

→ Internet: esg





| General technical data | | | | | |
|--------------------------------|---------|----------------------------------|-------------------------|-------------------------------|--|
| Allocating suction cup holders | | Size 3 | Size 4 | | |
| | | | For suction cup Ø 20 mm | For suction cup Ø 30/40/50 mm | |
| Pneumatic connection | | M4 | M6 | | |
| Vacuum connection | | M4 | M6 | | |
| Mounting position Any | | | | | |
| Type of mounting | | With male thread via vacuum port | | | |
| Grade of filtration | [µm] | 10 | | | |
| Flow rate ¹⁾ | [l/min] | 100 | 260 | 270 | |


¹⁾ At negative pressure = -0.75 bar

| Operating and environmental co | Operating and environmental conditions | | | | | |
|--|--|--|--|--|--|--|
| Operating pressure | [bar] | -0.95 +4 | | | | |
| Operating medium | | Atmospheric air based on ISO 8573-1:2010 [7:-:-] | | | | |
| Ambient temperature | [°C] | 0+60 | | | | |
| Corrosion resistance class CRC ¹⁾ | | 1 | | | | |

¹⁾ More information www.festo.com/x/topic/crc

| Materials | |
|------------------------|--------------------------------|
| Housing | Aluminium, nickel-plated brass |
| Filter | PVF |
| Seals | NBR |
| Note on materials | RoHS-compliant |
| LABS (PWIS) conformity | VDMA24364-A1-L |

Dimensions




| Download CAD data → | $\underline{www.festo.com}$ |
|---------------------|-----------------------------|
| | |

| Ordering data | | | | | | | | | |
|--------------------------------|----|----|-----|------|-----|----|--------|----------|--------|
| Allocating suction cup holders | D1 | D2 | D3 | L1 | L2 | L3 | Weight | Part no. | Туре |
| | Ø | | Ø | | | | [g] | | |
| Size 3 | 25 | M4 | 7.8 | 10.5 | 4.5 | 3 | 9 | 191202 | ESF-3 |
| Size 4 | 25 | M6 | 8.8 | 10.5 | 5.5 | 4 | 19 | 191203 | ESF-4A |
| | 40 | M6 | 8.8 | 14 | 5.5 | 4 | 19 | 191204 | ESF-4B |

Datasheet

Vacuum filter with transparent housing for identifying the degree of contamination.



The vacuum filter is used to filter particles in the suction direction.

The vacuum filter is inserted as an inline filter in the tubing line. When first installed, any flow direction can be chosen. Once the vacuum filter has been removed and refitted, the original flow direction must be maintained.



The fabric filter element is located in a transparent housing so that the degree of contamination of the filter cartridge can be determined. It is not possible to replace the filter.



Note

Only for use in open vacuum systems.


| General technical data | | | | | | |
|---------------------------|---------|----------------------|---------------------|---------------------|--|--|
| Pneumatic connection | | PK-3 with union nut | PK-4 with union nut | PK-6 with union nut | | |
| Nominal width | [mm] | 2 | 2 3 4.6 | | | |
| Mounting position | | Any | · | | | |
| Type of mounting | | In-line installation | | | | |
| Grade of filtration | [µm] | 50 | | | | |
| Flow rate ¹⁾ | [l/min] | 50.8 | 70 | 210 | | |
| Ejector pulse suitability | [bar] | ≤8 | | | | |

1) At negative pressure = -0.75 bar

| Operating and environmental co | Operating and environmental conditions | | | | | |
|----------------------------------|--|---|--|--|--|--|
| Operating pressure [bar] -0.95 0 | | | | | | |
| Note on operating pressure | | Only for use in open vacuum systems | | | | |
| Operating medium | | Compressed air to ISO 8573-1:2010 [7:-:-] | | | | |
| Ambient temperature | [°C] | 0+40 | | | | |

| Materials | |
|--|--|
| Housing | PA |
| Filter | Fabric, PA |
| Union nut | POM |
| Note on materials | RoHS-compliant |
| LABS (PWIS) conformity | VDMA24364-B1/B2-L |
| Suitability for the production of Li-ion | Metals with more than 1% by mass of copper, zinc or nickel by mass are excluded from use. Exceptions are nickel in steel, chemically nick- |
| batteries | el-plated surfaces, printed circuit boards, cables, electrical plug connectors and coils. |

Dimensions







- [1] Quick connector for plastic tubing
- [2] Flow direction indicated with arrow

Download CAD data → www.festo.com


[3] Degree of contamination visible through the transparent housing

| Ordering data | | | | | | | | |
|---------------|-----------------|----|----|------|--------------|--------|----------|----------|
| Connection | For tubing O.D. | D1 | D2 | L1 | = © 1 | Weight | Part no. | Туре |
| | | ø | ø | | | [g] | | |
| PK-3 | 4 | 16 | 12 | 50.8 | 8 | 4 | 535883 | VAF-PK-3 |
| PK-4 | 6 | 16 | 12 | 57 | 12 | 6 | 15889 | VAF-PK-4 |
| PK-6 | 8 | 24 | 19 | 64 | 14 | 10 | 160239 | VAF-PK-6 |

Vacuum filter VAF-DB

Datasheet

Vacuum filter with transparent bowl for identifying the degree of contamination.



The vacuum filter is used to filter particles in the suction direction.

The filter cartridge is located in a transparent bowl so that the degree of contamination of the filter cartridge can be determined. The filter cartridge can be replaced → page 7



- Note

Only for use in open vacuum systems.

| General technical data | | | | | | | | |
|----------------------------------|-------|---------------------------------|-----------------------------------|------|------|------|--|--|
| Pneumatic connection | | G1/4 | | G3/8 | | G1/2 | | |
| Vacuum connection G1/4 G3/8 G1/2 | | | | | G1/2 | | | |
| Mounting position | | Vertical | | | | | | |
| Type of mounting | | In-line installation | | | | | | |
| | | Via wall/surface bracket → page | Via wall/surface bracket → page 7 | | | | | |
| Grade of filtration | [µm] | 80 | 80 | | | | | |
| Ejector pulse suitability | [bar] | <u> </u> | | | | | | |
| Max. tightening torque | [Nm] | 8.7 | 8.7 15.3 20.5 | | | | | |


| Operating and environmental co | Operating and environmental conditions | | | | | |
|--------------------------------|--|---|--|--|--|--|
| Operating pressure | [bar] | -0.95 0 | | | | |
| Note on operating pressure | | Only for use in open vacuum systems | | | | |
| Operating medium | | Compressed air to ISO 8573-1:2010 [7:-:-] | | | | |
| Ambient temperature | [°C] | -5 +50 | | | | |

| Materials | |
|------------------------|-------------------------------|
| Housing | Reinforced PP |
| Bowl | PA |
| Filter | PU |
| Seals | NBR |
| Note on materials | RoHS-compliant RoHS-compliant |
| LABS (PWIS) conformity | VDMA24364 zone III |


Download CAD data → www.festo.com

Datasheet

Standard flow rate q_n as a function of differential pressure $\Delta p_{1\text{--}2}$

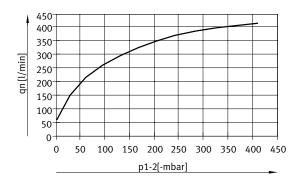


VAF-DB-1/4



VAF-DB-3/8
----- VAF-DB-1/2

Dimensions




| Ordering data | | | | | | | | | |
|------------------|------|------|------|---------------|----------|------------|--|--|--|
| Connection D1 | B1 | H1 | H2 | Weight [g] | Part no. | Туре | | | |
| 1/4 | 75 | 94.5 | 84.5 | 71 | 547261 | VAF-DB-1/4 | | | |
| 3/8 | 90.5 | 125 | 113 | 156 | 553140 | VAF-DB-3/8 | | | |
| 1/2 | 90.5 | 129 | 115 | 162 | 553141 | VAF-DB-1/2 | | | |

Datasheet

Accessories for vacuum generators OVEL

→ Internet: ovel





| General technical data | | | | | | |
|---------------------------|-------|---------|--|--|--|--|
| Type of mounting | | Push-on | | | | |
| | | Snap-in | | | | |
| Grade of filtration | [µm] | 40 | | | | |
| Ejector pulse suitability | [bar] | ≤7 | | | | |

| Operating and environmental conditions | | | | | |
|--|-------|--|--|--|--|
| Operating pressure [kPa] | | -95 0 | | | |
| [bar] -0.95 0 | | -0.95 0 | | | |
| | [psi] | -13.775 0 | | | |
| Operating medium | | Atmospheric air based on ISO 8573-1:2010 [7:-:-] | | | |
| Ejector pulse suitability [MPa] | | 0.7 | | | |
| [bar] 7 | | 7 | | | |
| | [psi] | 101.5 | | | |

| Materials | | | |
|------------------------|-------------------|-----------|--|
| Туре | OAFF-G3-5 | OAFF-G3-7 | |
| Housing | POM | | |
| Filter | Fabric, PA | | |
| Seals | - | NBR | |
| Note on materials | RoHS-compliant | | |
| LABS (PWIS) conformity | VDMA24364-B1/B2-L | | |

| Ordering data | | | | |
|--------------------------------|--------|----------|-----------|------------------|
| | Weight | Part no. | Туре | PU ¹⁾ |
| | [g] | | | |
| For vacuum generator OVEL-5 | 1 | 8068944 | OAFF-G3-5 | 10 |
| For vacuum generator OVEL-7/10 | 1.5 | 8068945 | OAFF-G3-7 | 10 |

¹⁾ Packaging unit


Accessories

Mounting bracket VAF-DB-HR

For vacuum filter VAF-DB

Type of mounting: threaded Max. tightening torque: 0.63 Nm



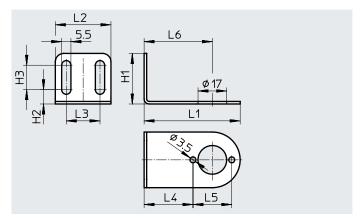

| Dimension | Dimensions and ordering data | | | | | | | | | | | |
|-----------|------------------------------|----|----|----|------|----|------|------|-------------------|--------|----------|-------------------|
| L1 | L2 | L3 | L4 | L5 | L6 | H1 | H2 | Н3 | CRC ¹⁾ | Weight | Part no. | Туре |
| | | | | | | | | | | [g] | | |
| 57 | 33 | 20 | 29 | 23 | 40.5 | 30 | 8.5 | 14.5 | 2 | 27 | 553144 | VAF-DB-HR-1/8-1/4 |
| 80 | 53 | 35 | 37 | 33 | 53.5 | 50 | 13.5 | 24.5 | 2 | 92 | 553145 | VAF-DB-HR-3/8-1/2 |

¹⁾ More information www.festo.com/x/topic/crc

| Materials | |
|------------------------|----------------------------|
| Mounting bracket | High-alloy stainless steel |
| Note on materials | RoHS-compliant |
| LABS (PWIS) conformity | VDMA24364 zone III |

Filter cartridge VAF-DB-P

For vacuum filter VAF-DB

Type of mounting: plug-in



| Materials | | | | | | |
|------------------------|--------------------|--|--|--|--|--|
| Filter | PU | | | | | |
| Note on materials | RoHS-compliant | | | | | |
| LABS (PWIS) conformity | VDMA24364 zone III | | | | | |

| Ordering data | | | | | | | | |
|--------------------------|----------|------------------|--|--|--|--|--|--|
| | Part no. | Туре | | | | | | |
| For vacuum filter VAF-DB | 553142 | VAF-DB-P-1/8-1/4 | | | | | | |
| | 553143 | VAF-DB-P-3/8-1/2 | | | | | | |